


Wet Location Emergency LED Lighting Installation Instructions

Contents

Part	Description	Quantity
1	Emergency Lighting	1
2	Hardware Kit	1

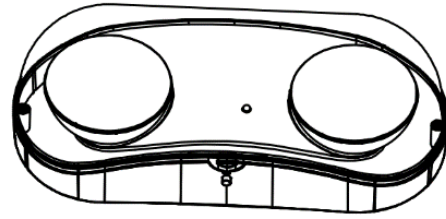

Warnings & Contents




IMPORTANT SAFEGUARDS
READ AND FOLLOW ALL SAFETY INSTRUCTIONS

1. Review the diagrams thoroughly before beginning.
2. All electrical connections must be in accordance with local codes, ordinances and the National Electric code.
3. Disconnect power at fuse or circuit breaker before installing or servicing.
4. Do not mount in hazardous locations, or near gas or electric heaters.
5. Do not let power cords touch hot surface.
6. Equipment should be mounted in locations and at heights where it will not be subjected to tampering by unauthorized personnel.
7. The use of accessory equipment not recommend by the manufacturer may cause an unsafe condition.
8. Do not use this equipment for other than intended use.
9. All servicing should be performed by qualified personnel only.
10. Allow battery to charge for 24 hours before first use.
11. For connection to a single source of supply such that all lamps are simultaneously illuminated.

SAVE THESE INSTRUCTIONS

Use Flexible Conduit Only

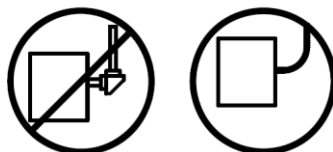


Mounting Instructions


NOTE: First turn off electricity

Wall Mounting (Max. Mounting Height: 7.49ft.



1. Using a Philips screwdriver to remove the diffuser.

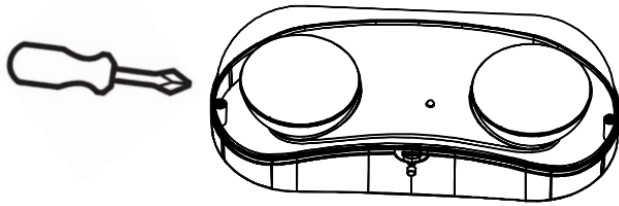

2. Using a straight screwdriver to remove fixture from mounting plate.

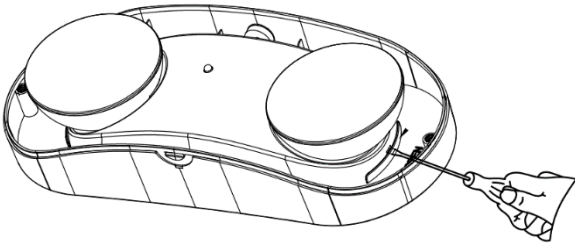

3. Knockout in back of mounting plate and push wires through the hole.
4. Remove backing from self-adhesive junction box gasket and adhere to back plate.
5. Securely attach mounting plate to J-box.

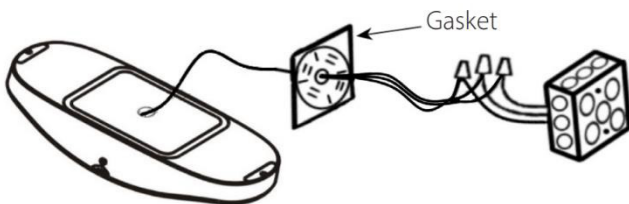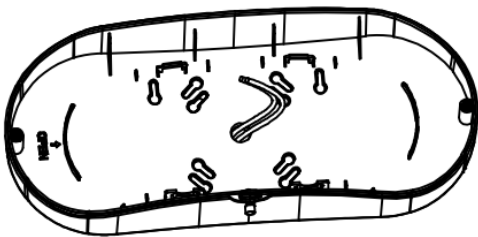


6. Electrical Connections

Make the proper supply wire connections.


Connect the black and white wires to the building utility.

CAUTION:

For a watertight seal, install only on a flat wall surface.

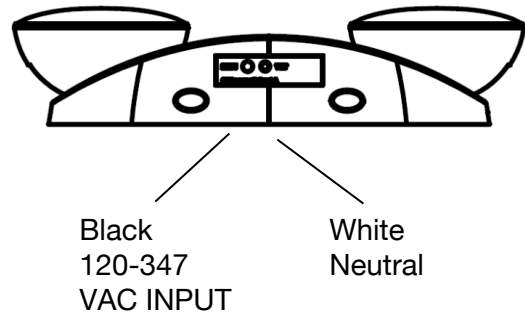

7. Connect the battery to connector on the PCBA.

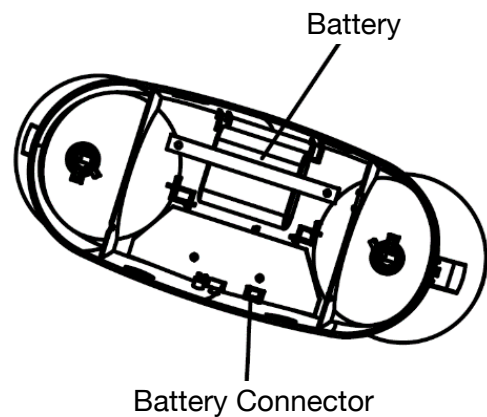

8. Snap fixture onto mounting plate and ensure no wires are pinched. Make sure unit is fully attached.
9. Restore power and press test button. Battery red LED will come on, AC light will turn off.