


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:119.80V I:0.1292A P:14.642W PF:0.9461 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:810.407x1 lm		
NAME: PLT-12407	TYPE:	WEIGHT:
SPEC.: 3000K	DIM.:	SERIAL No.:
MFR.: 1000B	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 55.35 lm/W			
MODEL		Imax (cd)	280.1	S/MH(C0/180)	1.29
NOMINAL POWER(W)	15	LOR(%)	100.0	S/MH(C90/270)	1.25
RATED VOLTAGE(V)	120	TOTAL FLUX(lm)	810.41	η UP,DN(C0-180)	0.0,50.5
NOMINAL FLUX(lm)	810.407	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,49.5
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	1.25
TEST VOLTAGE(V)	120	η down (%)	100.0	CIBSE SHR MAX	1.35

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

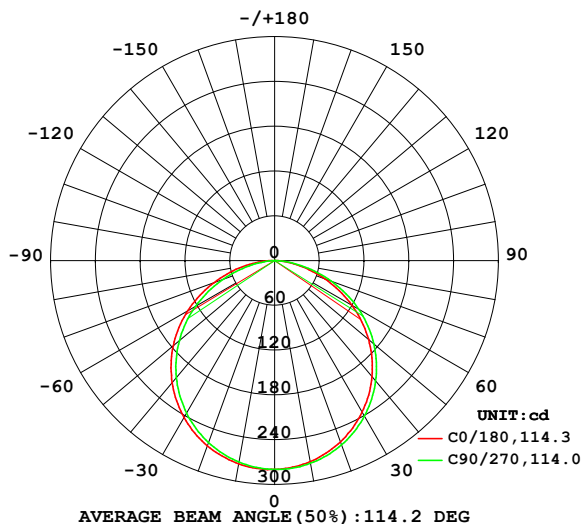

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

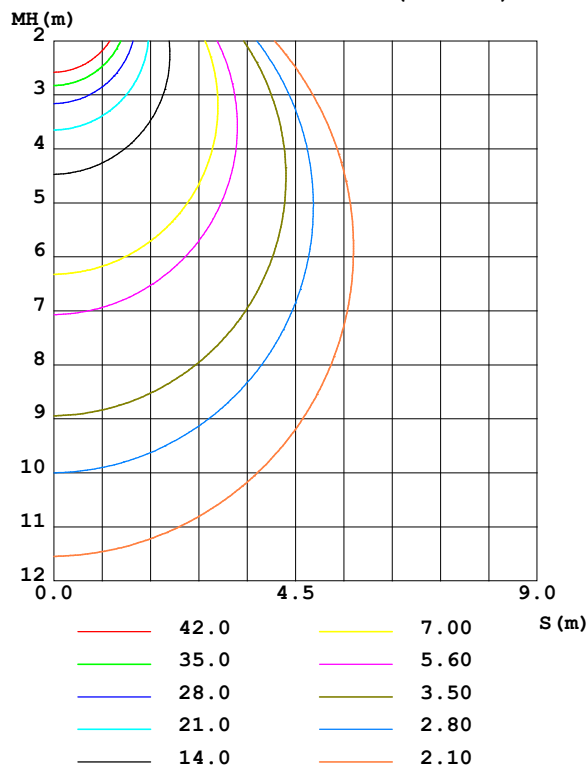

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3 °C
Operators:
Test Date: 2022-06-08

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.460
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:


γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	273.5	274.9	275.9	276.7	276.6	275.5	274.1	273.5	0- 10	26.49	26.49	3.27,3.27
20	258.3	260.6	262.7	264.4	264.1	261.9	259.4	258.0	10- 20	76.01	102.5	12.6,12.6
30	234.5	237.7	240.7	243.1	242.9	239.5	236.0	233.9	20- 30	115.7	218.2	26.9,26.9
40	203.0	206.8	210.7	214.0	213.8	209.5	204.9	202.1	30- 40	140.3	358.5	44.2,44.2
50	164.5	168.9	173.7	177.7	177.3	172.3	166.7	163.5	40- 50	146.6	505.1	62.3,62.3
60	119.5	124.6	129.9	134.7	134.2	128.3	122.1	118.4	50- 60	133.3	638.4	78.8,78.8
70	71.67	76.30	80.77	86.39	86.51	80.00	73.26	70.21	60- 70	101.4	739.8	91.3,91.3
80	26.32	29.43	32.30	37.30	38.99	33.02	26.69	25.27	70- 80	57.18	797.0	98.3,98.3
90	0.3455	0.3160	0.2964	0.3097	2.339	0.2010	0.2024	0.2281	80- 90	13.42	810.4	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:
Test Date:2022-06-08

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.460
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

Test: U:119.80V I:0.1292A P:14.642W PF:0.9461 Freq:59.98Hz UTHDi: 0.00% ITHDi: 0.00% KDisp: 0 Lamp Flux: 810.407x1 lm		
NAME: PLT-12407	TYPE:	WEIGHT:
SPEC.: 3000K	DIM.:	SERIAL No.:
MFR.: 1000B	SUR.:	Shielding Angle:

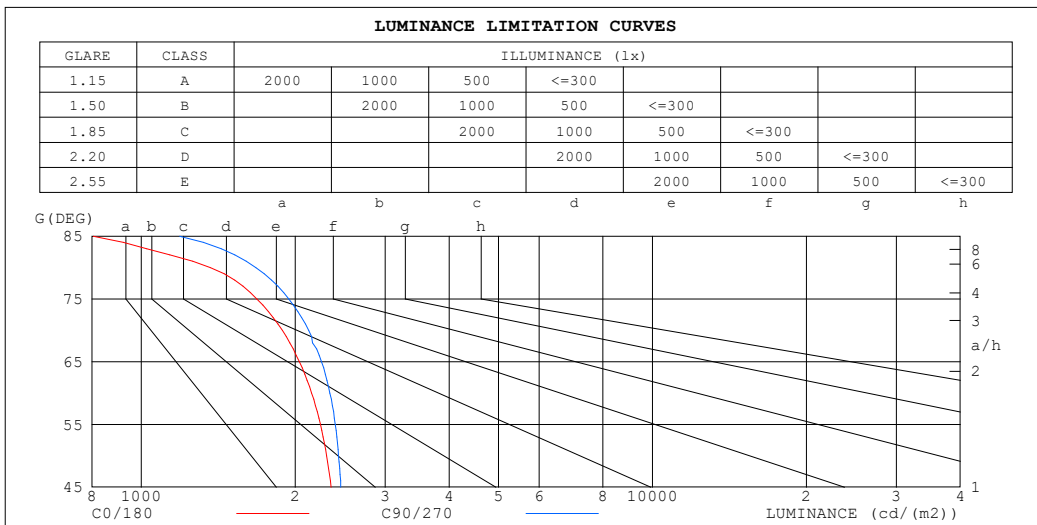

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	805	1189
80	1365	1674
75	1682	1943
70	1887	2125
65	2039	2251
60	2152	2338
55	2240	2395
50	2305	2431
45	2350	2456


C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3 °C
 Operators:
 Test Date: 2022-06-08

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.460
 Humidity: 65.0%
 Test Distance: 3.090m [K=1.0000]
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:119.80V I:0.1292A P:14.642W PF:0.9461 Freq:59.98Hz			UTHDi:0.00% ITHDi:0.00% KDisp:0			Lamp Flux:810.407x1 lm		
NAME: PLT-12407			TYPE:			WEIGHT:		
SPEC.: 3000K			DIM.:			SERIAL No.:		
MFR.: 1000B			SUR.:			Shielding Angle:		

pcc	80%			70%			50%			30%			10%			0														
p _w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
p _{fc}	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Coefficients of Utilization(CU)														
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00														
1.0	1.04	.00	.96	1.02	.98	.94	.97	.94	.91	.93	.91	.88	.90	.88	.86	.84														
2.0	.90	.84	.78	.89	.82	.77	.85	.80	.75	.82	.77	.73	.79	.75	.72	.70														
3.0	.79	.71	.64	.78	.70	.64	.75	.68	.63	.72	.66	.62	.69	.65	.61	.58														
4.0	.70	.61	.55	.69	.61	.54	.66	.59	.53	.64	.58	.53	.62	.56	.52	.50														
5.0	.63	.54	.47	.61	.53	.47	.59	.52	.46	.57	.51	.46	.55	.50	.45	.43														
6.0	.56	.47	.41	.55	.47	.41	.54	.46	.40	.52	.45	.40	.50	.44	.40	.37														
7.0	.51	.42	.36	.50	.42	.36	.49	.41	.36	.47	.40	.35	.46	.40	.35	.33														
8.0	.47	.38	.32	.46	.38	.32	.44	.37	.32	.43	.36	.32	.42	.36	.31	.29														
9.0	.43	.34	.29	.42	.34	.29	.41	.34	.29	.40	.33	.28	.39	.33	.28	.26														
10.0	.39	.31	.26	.39	.31	.26	.38	.31	.26	.37	.30	.26	.36	.30	.26	.24														

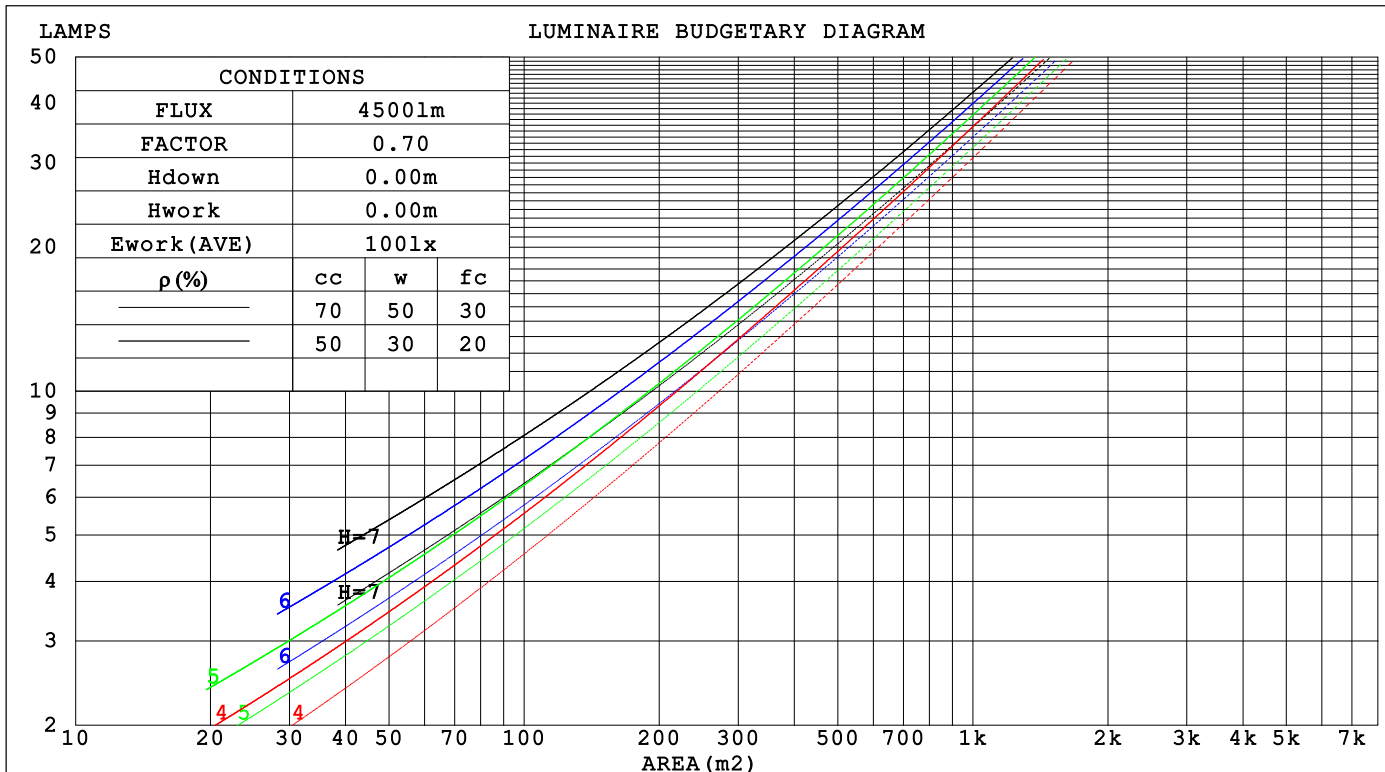

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:
Test Date:2022-06-08

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.460
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:119.80V I:0.1292A P:14.642W PF:0.9461 Freq:59.98Hz			UTHDi:0.00% ITHDi:0.00% KDisp:0			Lamp Flux:810.407x1 lm		
NAME: PLT-12407		TYPE:		WEIGHT:				
SPEC.: 3000K		DIM.:		SERIAL No.:				
MFR.: 1000B		SUR.:		Shielding Angle:				

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.309	.176	.056	.302	.172	.055	.288	.165	.053	.276	.159	.051	.265	.154	.049		
2.0	.292	.160	.049	.285	.157	.048	.274	.152	.047	.263	.148	.046	.253	.143	.045		
3.0	.270	.144	.043	.265	.142	.043	.255	.138	.042	.245	.134	.041	.236	.131	.040		
4.0	.250	.130	.038	.245	.128	.038	.236	.125	.037	.227	.122	.037	.219	.119	.036		
5.0	.231	.118	.034	.227	.116	.034	.218	.114	.033	.211	.111	.033	.204	.109	.033		
6.0	.214	.107	.031	.210	.106	.031	.203	.104	.030	.196	.102	.030	.190	.100	.030		
7.0	.199	.099	.028	.196	.098	.028	.189	.096	.028	.183	.094	.027	.178	.092	.027		
8.0	.186	.091	.026	.183	.090	.025	.177	.089	.025	.172	.087	.025	.167	.086	.025		
9.0	.174	.084	.024	.172	.084	.023	.166	.082	.023	.162	.081	.023	.157	.080	.023		
10.0	.164	.079	.022	.162	.078	.022	.157	.077	.022	.152	.076	.022	.148	.075	.021		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.180	.156	.134	.154	.134	.116	.105	.092	.080	.061	.053	.047	.019	.017	.015		
2.0	.172	.132	.098	.148	.114	.085	.101	.079	.059	.058	.046	.035	.019	.015	.011		
3.0	.165	.114	.074	.141	.099	.064	.097	.069	.045	.056	.040	.027	.018	.013	.009		
4.0	.157	.101	.058	.135	.087	.051	.093	.061	.036	.054	.036	.021	.017	.012	.007		
5.0	.150	.091	.047	.128	.078	.041	.088	.055	.029	.051	.032	.017	.017	.010	.006		
6.0	.142	.082	.039	.122	.071	.034	.084	.050	.024	.049	.029	.014	.016	.010	.005		
7.0	.136	.075	.033	.117	.065	.029	.081	.046	.020	.047	.027	.012	.015	.009	.004		
8.0	.129	.070	.029	.111	.060	.025	.077	.042	.018	.045	.025	.011	.014	.008	.003		
9.0	.123	.065	.025	.106	.056	.022	.073	.039	.016	.043	.023	.009	.014	.008	.003		
10.0	.117	.060	.022	.101	.052	.020	.070	.037	.014	.041	.022	.008	.013	.007	.003		

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:
Test Date:2022-06-08

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.460
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:119.80V I:0.1292A P:14.642W PF:0.9461 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:810.407x1 lm										
NAME: PLT-12407					TYPE:			WEIGHT:		
SPEC.: 3000K					DIM.:			SERIAL No.:		
MFR.: 1000B					SUR.:			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	16.4	17.9	16.7	18.1	18.3	16.7	18.2	16.9	18.4	18.6
3H	17.8	19.2	18.1	19.4	19.7	18.2	19.6	18.5	19.9	20.1
4H	18.3	19.7	18.6	19.9	20.2	18.8	20.1	19.1	20.4	20.7
6H	18.7	19.9	19.0	20.2	20.5	19.2	20.5	19.5	20.7	21.0
8H	18.7	19.9	19.1	20.2	20.5	19.3	20.5	19.7	20.8	21.1
12H	18.7	19.9	19.1	20.2	20.5	19.4	20.5	19.7	20.8	21.1
4H 2H	17.0	18.4	17.3	18.6	18.9	17.2	18.6	17.6	18.8	19.1
3H	18.6	19.8	19.0	20.1	20.4	19.0	20.1	19.3	20.4	20.7
4H	19.3	20.3	19.6	20.7	21.0	19.7	20.7	20.0	21.1	21.4
6H	19.7	20.7	20.1	21.0	21.4	20.2	21.1	20.6	21.5	21.9
8H	19.8	20.7	20.2	21.1	21.4	20.3	21.2	20.8	21.6	22.0
12H	19.8	20.6	20.3	21.0	21.4	20.4	21.2	20.9	21.6	22.0
8H 4H	19.5	20.4	19.9	20.8	21.2	19.9	20.8	20.3	21.1	21.5
6H	20.1	20.8	20.5	21.2	21.7	20.5	21.3	21.0	21.7	22.1
8H	20.2	20.9	20.7	21.3	21.8	20.8	21.4	21.2	21.8	22.3
12H	20.3	20.9	20.8	21.3	21.8	20.9	21.5	21.4	21.9	22.4
12H 4H	19.5	20.4	20.0	20.7	21.1	19.9	20.7	20.3	21.1	21.5
6H	20.1	20.8	20.6	21.2	21.7	20.6	21.2	21.0	21.6	22.1
8H	20.3	20.9	20.8	21.3	21.8	20.8	21.4	21.3	21.8	22.3
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 0.2 / - 0.2					+ 0.2 / - 0.2				
1.5H	+ 0.2 / - 0.3					+ 0.2 / - 0.3				
2.0H	+ 0.2 / - 0.3					+ 0.2 / - 0.3				

CIE Pub.117, 810.4 lm Total Lamp Luminous Flux Correct (8log(F/F0) = -0.7)
Area: 0.111111 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:
Test Date:2022-06-08

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.460
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:119.80V I:0.1292A P:14.642W PF:0.9461 Freq:59.98Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:810.407x1 lm		
NAME: PLT-12407	TYPE:	WEIGHT:
SPEC.: 3000K	DIM.:	SERIAL No.:
MFR.: 1000B	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	57	46	39	57	45	38	55	45	38	32
0.80	67	56	48	66	55	48	65	54	48	41
1.00	76	65	57	75	64	57	72	65	57	49
1.25	83	72	65	82	72	65	79	70	64	57
1.50	88	78	71	86	77	71	83	75	69	62
2.00	95	86	80	93	85	79	90	83	78	70
2.50	99	91	85	97	90	84	93	87	82	74
3.00	102	95	90	100	94	89	96	91	87	78
4.00	106	101	96	104	99	95	100	95	92	83
5.00	109	104	100	106	102	98	102	98	95	86
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3 °C
Operators:
Test Date: 2022-06-08

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.460
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:119.80V I:0.1292A P:14.642W PF:0.9461 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:810.407x1 lm		
NAME: PLT-12407	TYPE:	WEIGHT:
SPEC.: 3000K	DIM.:	SERIAL No.:
MFR.: 1000B	SUR.:	Shielding Angle:

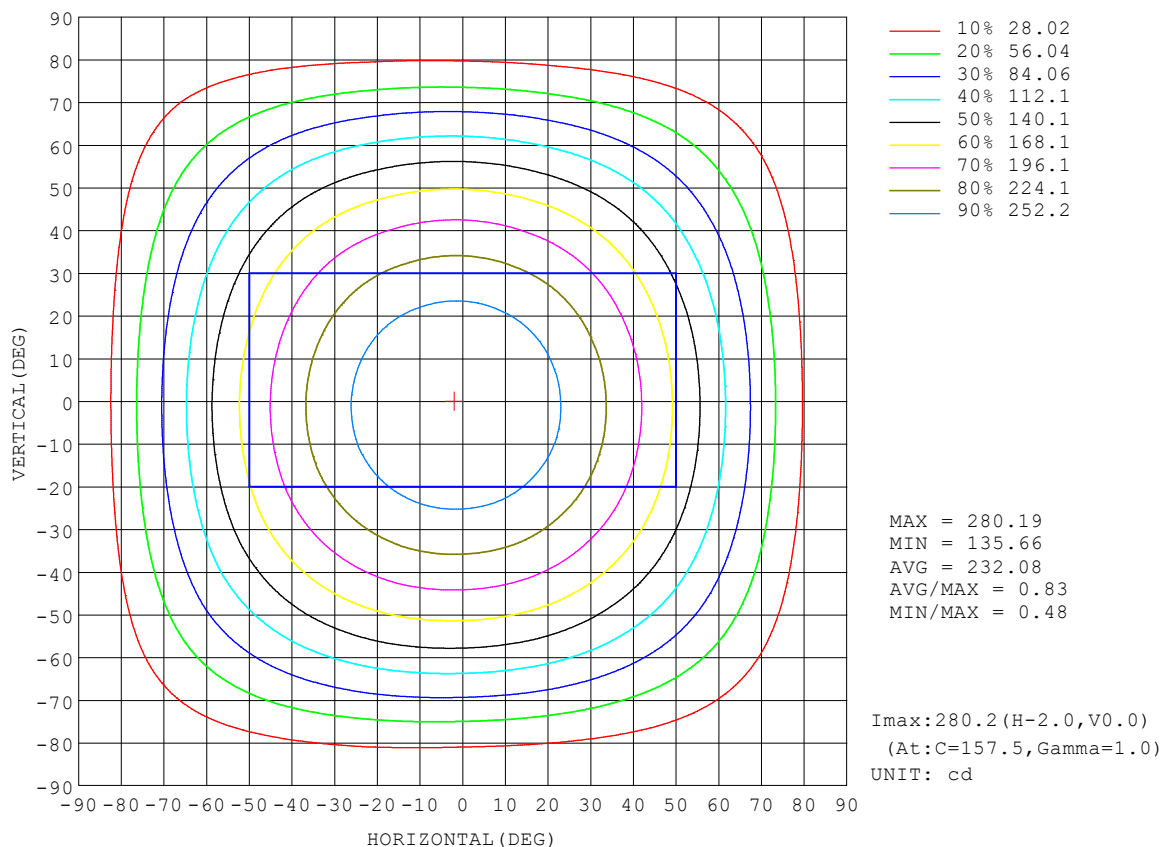


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:
Test Date:2022-06-08

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.460
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

AAI Figure

Test:U:119.80V I:0.1292A P:14.642W PF:0.9461 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:810.407x1 lm		
NAME: PLT-12407	TYPE:	WEIGHT:
SPEC.: 3000K	DIM.:	SERIAL No.:
MFR.: 1000B	SUR.:	Shielding Angle:

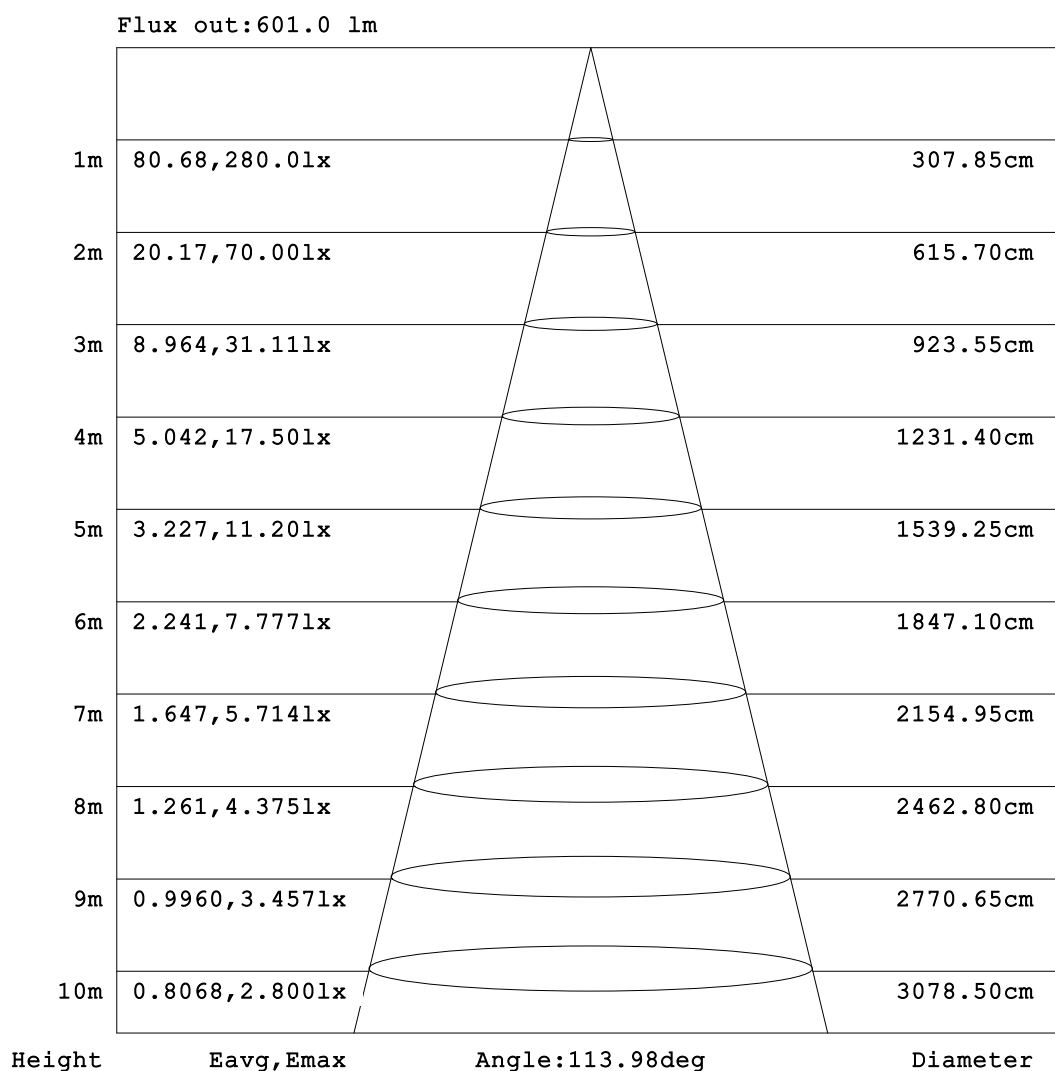


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3℃
 Operators:
 Test Date:2022-06-08

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.460
 Humidity:65.0%
 Test Distance:3.090m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

Test:U:119.80V I:0.1292A P:14.642W PF:0.9461 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:810.407x1 lm		
NAME: PLT-12407	TYPE:	WEIGHT:
SPEC.: 3000K	DIM.:	SERIAL No.:
MFR.: 1000B	SUR.:	Shielding Angle:

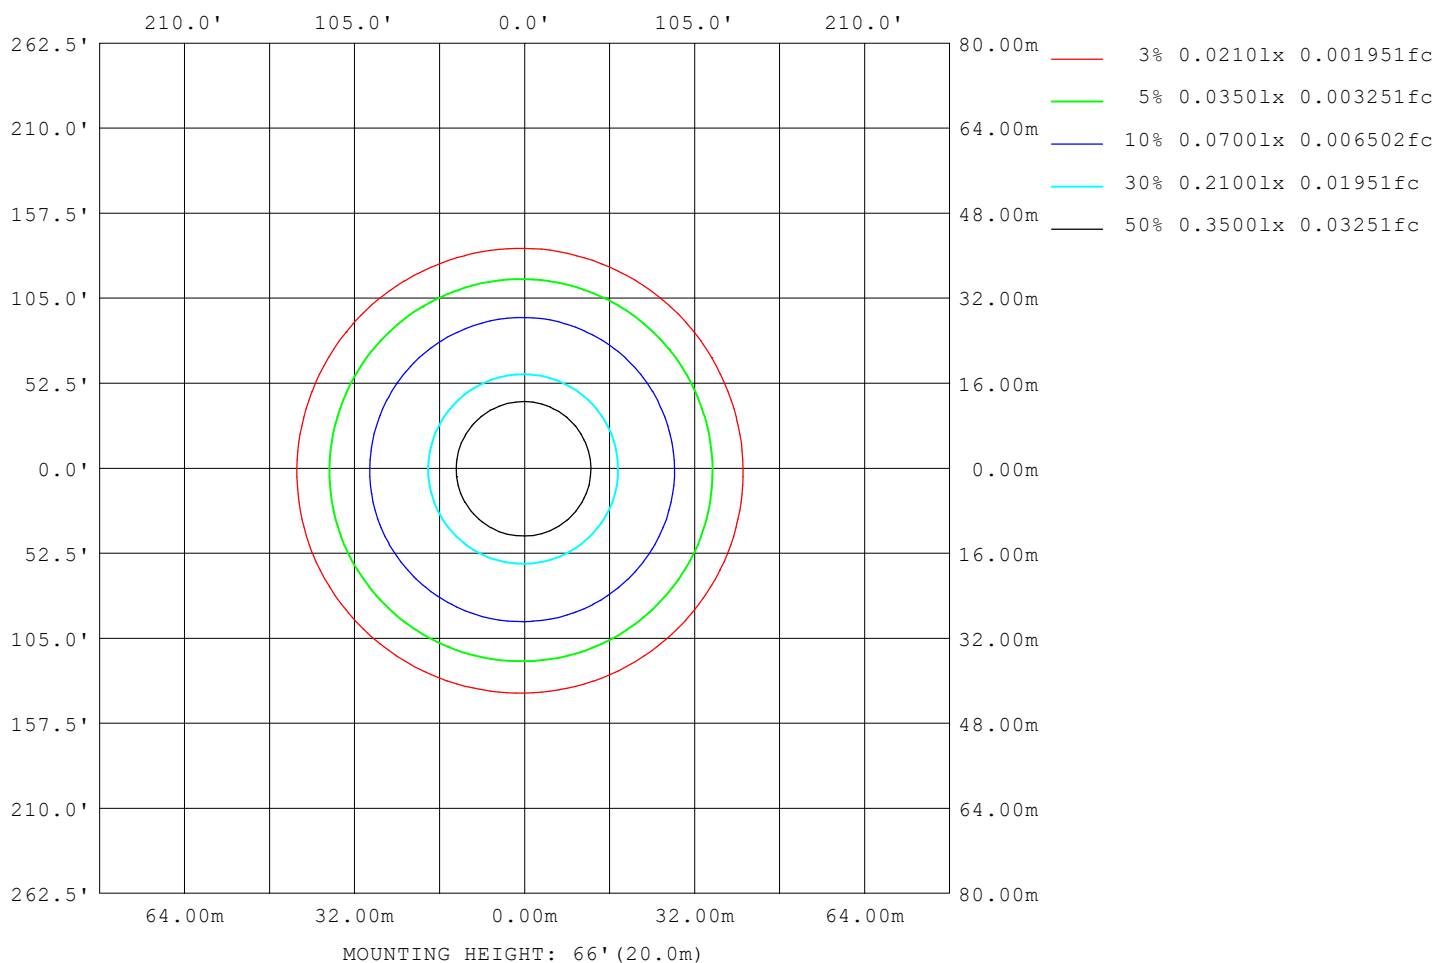

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:
Test Date:2022-06-08

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.460
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:119.80V I:0.1292A P:14.642W PF:0.9461 Freq:59.98Hz UTHDi:0.00% ITHDi:0.00% KDisp:0 Lamp Flux:810.407x1 lm		
NAME: PLT-12407	TYPE:	WEIGHT:
SPEC.: 3000K	DIM.:	SERIAL No.:
MFR.: 1000B	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	2197
L_0~180 (75) av	1927
L_0~180 (85) av	1348
L_90~270 (65) av	2168
L_90~270 (75) av	1823
L_90~270 (85) av	981
L_45 (65) av	2185
L_45 (75) av	1881
L_45 (85) av	1123

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:
Test Date:2022-06-08

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.460
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

Planar Illuminance Curve

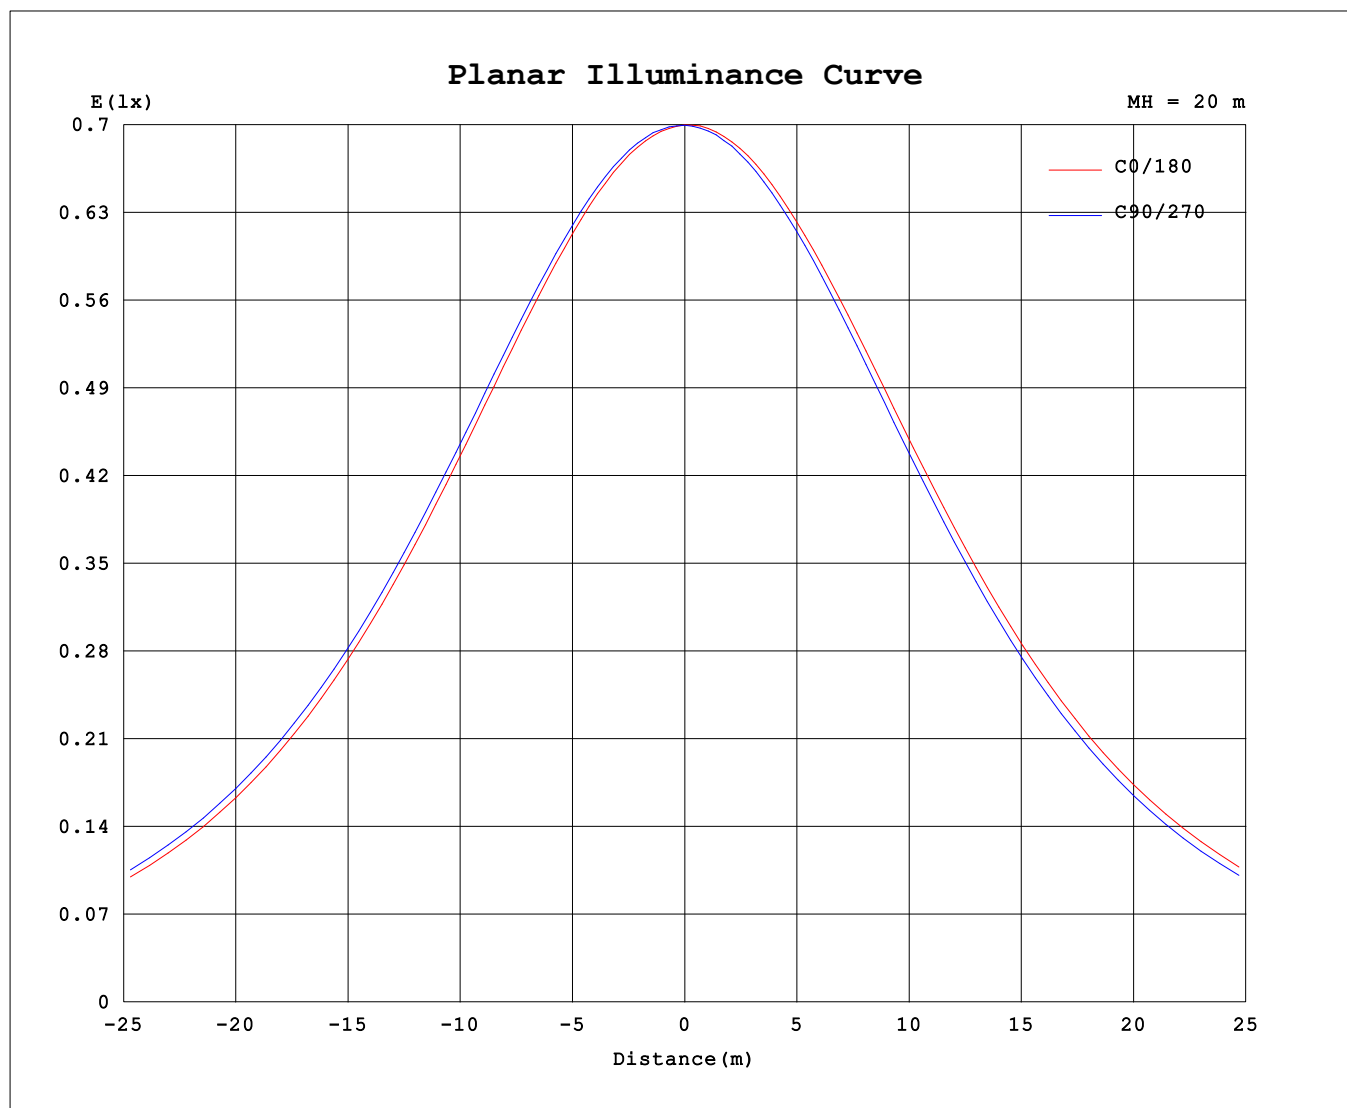

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3 °C
Operators:
Test Date: 2022-06-08

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.460
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.460
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```